

MASSACHUSETTS WATER RESOURCES AUTHORITY  
100 First Avenue, Charlestown Navy Yard, Boston, MA 02129



## WATER QUALITY UPDATE

### **An Analysis of September 2021 Sampling Data**

*For more information, please contact MWRA at (617) 242-5323, or visit [www.mwra.com](http://www.mwra.com).*

### **September 2021 Highlights**

- In September, MWRA met all regulatory targets for pathogen inactivation at Brutsch Water Treatment Facility and Carroll Water Treatment Plant**, achieving greater than the required 99% *Cryptosporidium* inactivation and 99.9% *Giardia* inactivation at all times. See pages 5 and 6.
- MWRA met all regulatory targets for the month**. Nine communities triggered the requirement for an Assessment under the Revised Total Coliform Rule. See Page 7.
- To reduce printing and postage costs and also to provide the most detailed version, starting in 2015 MWRA has switched to an electronic distribution of the report.**

**We are continually updating the report. Let us know what you think.**

**Call (617) 788-4822 or email [Beverly.Anderson@mwra.com](mailto:Beverly.Anderson@mwra.com)**

**Release Date: October 20, 2021**

## Water Quality Update


This is a monthly report about the quality of water supplied by MWRA. It provides a more detailed review than the annual water quality report that is mailed each June. The reports are available at [www.mwra.com](http://www.mwra.com). Data within this report are subject to verification and correction.

## The Water System

The MWRA supplies wholesale water to local water departments in 53 communities, 47 in greater Boston and MetroWest, three in Western Massachusetts, and as a back-up supply for three others. Each municipality is responsible for distributing the water within its own community. More than two million people are served by the MWRA water supply system, and about 200 million gallons are supplied each day. Quabbin Reservoir is the primary source of water for the whole MWRA system, and one of the country's largest reservoirs, with a capacity of 412 billion gallons. Within this report, Quabbin water represents source water for the three communities in the Chicopee Valley Aqueduct (CVA) system (Chicopee, Wilbraham and South Hadley FD1).

Water is then transferred from Quabbin Reservoir to the 65 billion gallon Wachusett Reservoir in Clinton via the Quabbin Aqueduct. Within this report, Wachusett water represents source water for MetroWest and Metropolitan Boston communities. The 401-square mile watershed areas of the Quabbin and Wachusett Reservoirs are naturally protected with over 85% of the watersheds covered in forest and wetlands. To ensure the safety of the water, the Department of Conservation and Recreation (DCR) patrols the watersheds, and with cooperation from MWRA, tests the streams and reservoirs frequently.

The map below indicates the location of reservoirs, treatment facilities, and service communities.

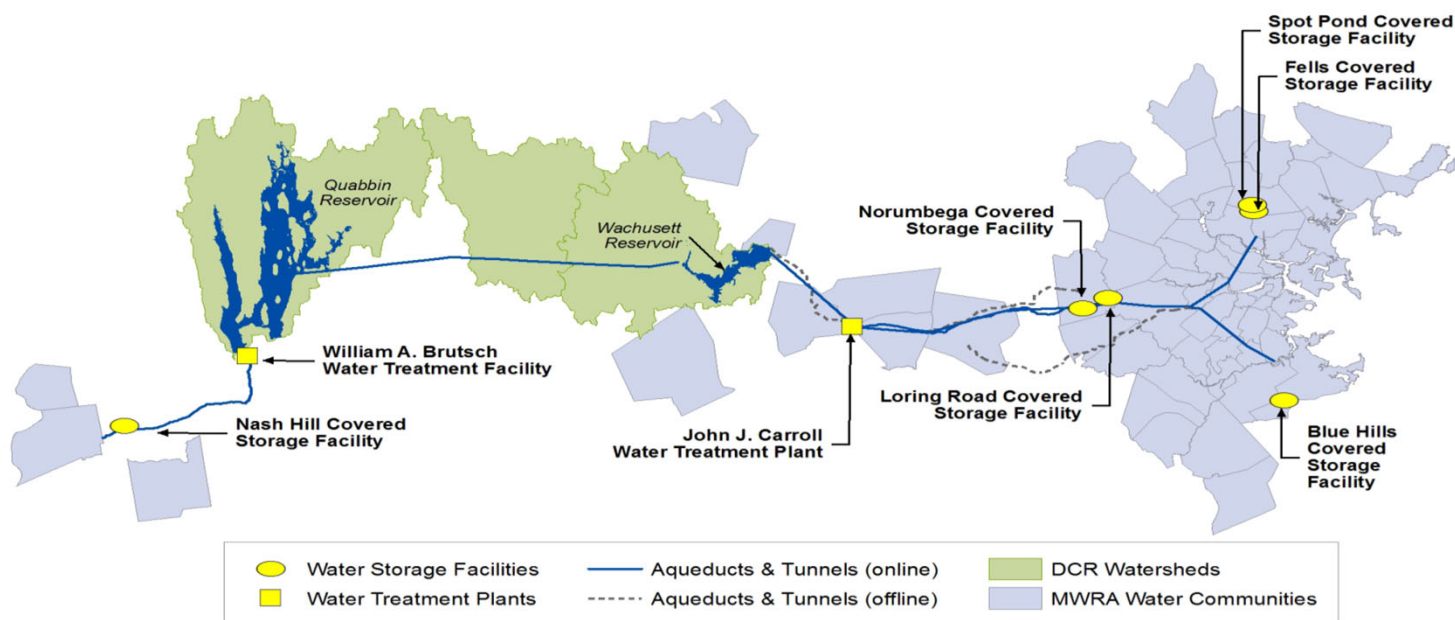

## Water Treatment

The water MWRA supplies from the Wachusett Reservoir is treated at the state-of-the-art John J. Carroll Treatment Plant. The water is treated with ozone, sodium bisulfite for ozone quench, ultra-violet light (UV), sodium carbonate and carbon dioxide for corrosion control, fluoride, and chloramines. Water supplied from the Quabbin Reservoir is treated at the William A. Brutsch Water Treatment Facility with UV and chlorine. Each of the three CVA communities provides corrosion control.

## Indicators of Water Quality

MWRA tests the water extensively for over 120 different contaminants and parameters across the system; this includes several hundred thousand tests each year. EPA and MA DEP set the standards for source and treated water quality, and include standards for total and fecal coliform, turbidity, disinfection and disinfection by-products, pathogens, metals, and other potential chemical contaminants. A full list is available at [www.mwra.com](http://www.mwra.com). Tests are conducted on water sampled at the source reservoirs (source or "raw water") and also on water after treatment ("treated water"). MWRA also routinely monitors for a variety of parameters that tell us about disinfection, corrosivity, and the organic and inorganic constituents in the water. Testing frequencies vary by parameter.

Customer communities must also meet certain standards under the EPA regulations concerning distribution of treated drinking water. The Total Coliform Rule (TCR) helps to alert communities to possible microbial contamination as well as the adequacy of residual disinfection within the local distribution system. MWRA tests over 2,000 community samples per month.

# Source Water – Microbial and UV Results

## September 2021

### Source Water - Microbial Results

Total coliform bacteria are monitored in both source and treated water to provide an indication of overall bacteriological activity. Most coliforms are harmless. However, fecal coliform, a subclass of the coliform group, are identified by their growth at temperatures comparable to those in the intestinal tract of mammals. They act as indicators of possible fecal contamination. The Surface Water Treatment Rule for unfiltered water supplies allows for no more than 10% of source water samples prior to disinfection over any six-month period to have more than 20 fecal coliforms per 100mL.

### Sample Site: Quabbin Reservoir

Quabbin Reservoir water is sampled at the Brutsch Water Treatment Facility raw water tap before being treated and entering the CVA system.

Nine of the 30 samples were positive during September. None of the samples exceeded a count of 20 cfu/100mL. **For the current six-month period, 0.0% of the samples have exceeded a count of 20 cfu/100mL.**

### Sample Site: Wachusett Reservoir

Wachusett Reservoir water is sampled at the Carroll Water Treatment Plant raw water tap in Marlborough before being treated and entering the MetroWest/Metropolitan Boston systems.

In the wintertime when smaller water bodies near Wachusett Reservoir freeze up, many waterfowl will roost in the main body of the reservoir - which freezes later. This increased bird activity tends to increase fecal coliform counts. DCR has an active bird harassment program to move the birds away from the intake area.

Twenty-two of the 30 samples were positive during September. None of the samples exceeded a count of 20 cfu/100mL. **For the current six-month period, 0.0% of the samples have exceeded a count of 20 cfu/100mL.**


### Source Water - UV Absorbance

UV Absorbance at 254nm wavelength (UV-254), is a measure of the amount and reactivity of natural organic material in source water. Higher UV-254 levels cause increased ozone and chlorine demand resulting in the need for higher ozone and chlorine doses, and can increase the level of disinfection by-products. UV-254 is impacted by tributary flows, water age, sunlight and other factors.


Quabbin Reservoir UV-254 levels averaged 0.026 A/cm for the month.

Wachusett Reservoir UV-254 levels averaged 0.091 A/cm for the month.


Quabbin Reservoir  
Fecal Coliform Levels Before Disinfection

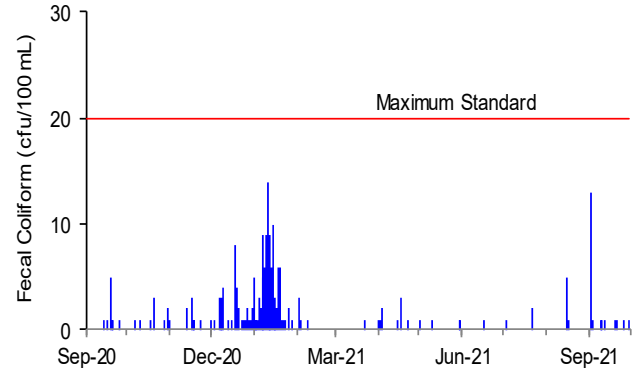

Wachusett Reservoir  
Fecal Coliform Levels Before Disinfection

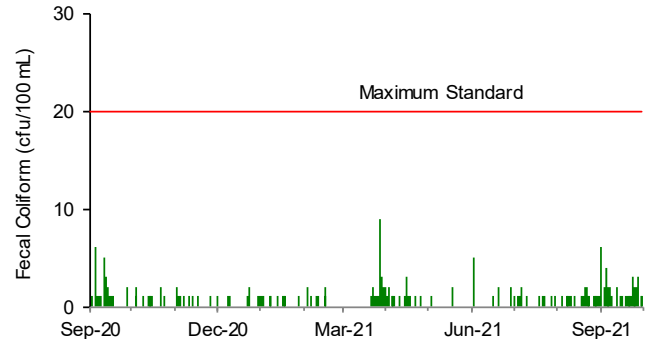

UV 254  
Reservoir Source Water  
Grab Data

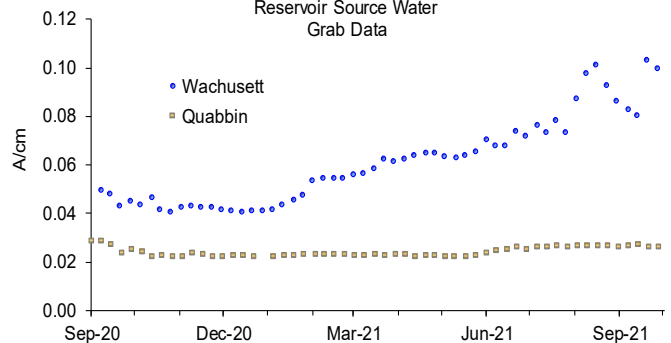

# Source Water – Turbidity and Algae Results



## September 2021

### Source Water - Turbidity Results

Turbidity is a measure of suspended and colloidal particles including clay, silt, organic and inorganic matter, algae and microorganisms. The effects of turbidity depend on the nature of the matter that causes the turbidity. High levels of particulate matter may have a higher disinfectant demand or may protect bacteria from disinfection effects, thereby interfering with the disinfectant residual throughout the distribution system.

There are two standards for turbidity: all water must be below five NTU (Nephelometric Turbidity Units), and water can only be above one NTU if it does not interfere with effective disinfection.

Turbidity of Quabbin Reservoir water is monitored continuously at the Brutsch Water Treatment Facility (BWTF) before UV and chlorine disinfection. Turbidity of Wachusett Reservoir is monitored continuously at the Carroll Water Treatment Plant (CWTP) before ozonation and UV disinfection. Maximum turbidity results at Quabbin and Wachusett were within DEP standards for the month.

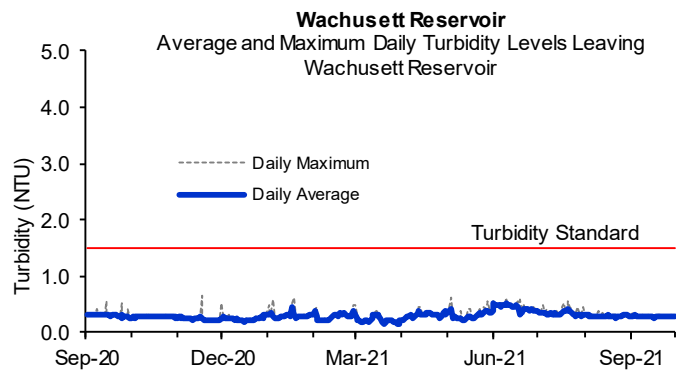
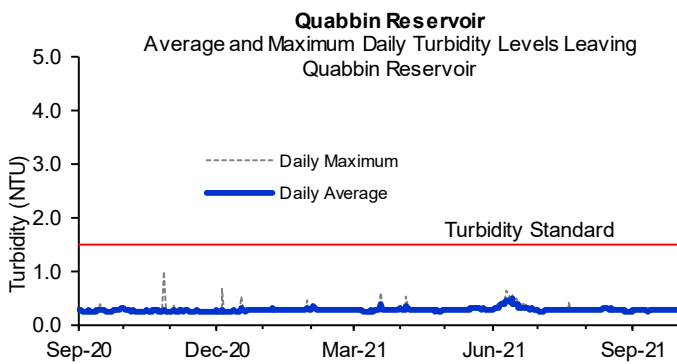


### Source Water - Algae Levels

Algae levels in the Wachusett and Quabbin Reservoir are monitored by DCR and MWRA. These results, along with taste and odor complaints, are used to make decisions on source water treatment for algae control.

Taste and odor complaints at the tap may be due to algae, which originate in source reservoirs, typically in trace amounts. Occasionally, a particular species grows rapidly, increasing its concentration in water. When *Synura*, *Dolichospermum* (formerly called Anabaena), or other nuisance algae bloom, MWRA may treat the reservoirs with copper sulfate, an algacide. During the winter and spring, diatom numbers may increase. While diatoms are not a taste and odor concern, consumers using filters may notice more frequent changing of the filters is needed.

No complaints which may be related to algae were reported during September from local water departments.

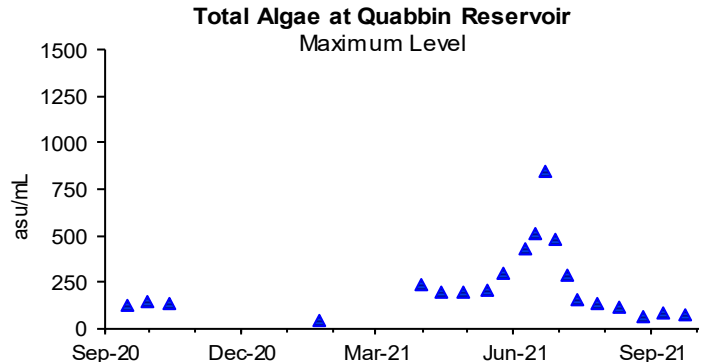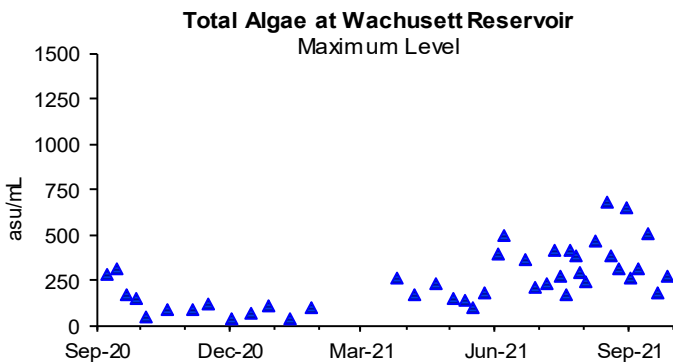

# Treated Water – Disinfection Results

## September 2021





### Treated Water - Primary Disinfection

At the Carroll Water Treatment Plant (CWTP), MWRA meets the required 99.9% (3-log) inactivation of *Giardia* using ozone (reported as CT: concentration of disinfectant x contact time) and the required 99% (2-log) inactivation of *Cryptosporidium* using UV (reported as IT: intensity of UV x time). MWRA calculates inactivation rates hourly and reports *Giardia* inactivation at maximum flow and *Cryptosporidium* inactivation at minimum UV dose. MWRA must meet at least 100% of required CT and IT.

CT achievement for *Giardia* assures CT achievement for viruses, which have a lower CT requirement. For *Cryptosporidium*, there is also an “off-spec” requirement. Off-spec water is water that has not reached the full required UV dose or if the UV reactor is operated outside its validated ranges. No more than 5% off-spec water is allowed in a month.

### Wachusett Reservoir - MetroWest/MetroBoston Supply





- Ozone dose at the CWTP varied between 3.2 to 4.3 mg/L for September.
- Giardia* CT was maintained above 100% at all times the plant was providing water into the distribution system for September.
- Cryptosporidium* IT was maintained above 100% during the month. Off-spec water was less than 5%.
- The ozone dose was proactively raised in 2020 from mid-August until mid-October in response to elevated reservoir total coliform levels. This is visible in the top left graph.
- The slight decrease in *Giardia* CT Achievement on December 21, 2020 was due to Train B returning to service after undergoing winter maintenance. *Giardia* CT Achievement was met this day. This is visible in the top left graph.
- The ozone target was increased in mid-August 2021 in an effort to reduce chlorine demand and decay, as chlorine residuals have declined in the distribution system.

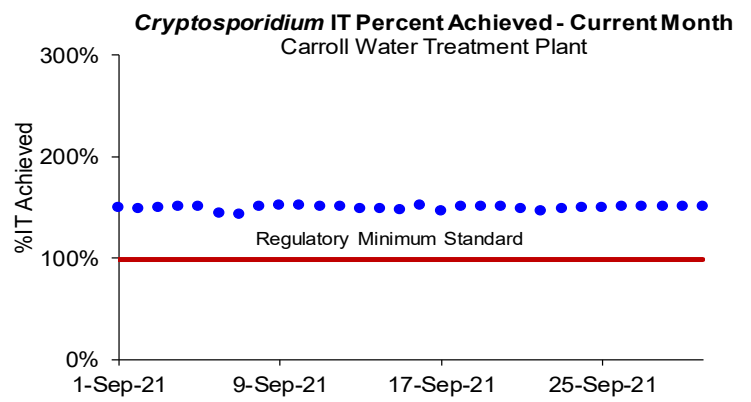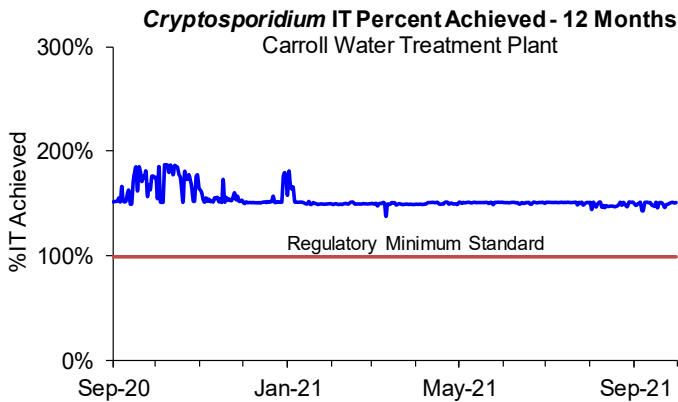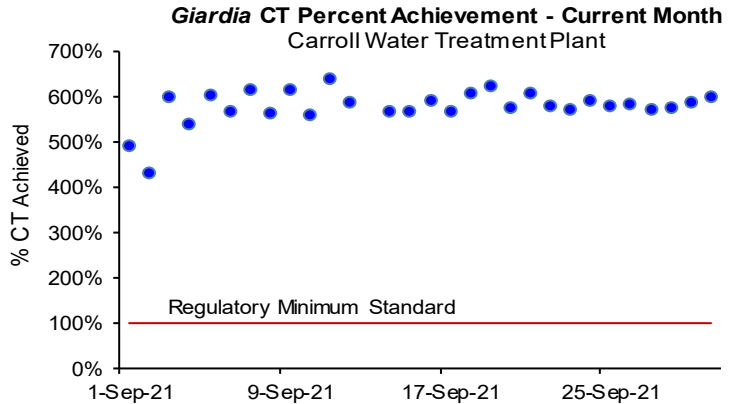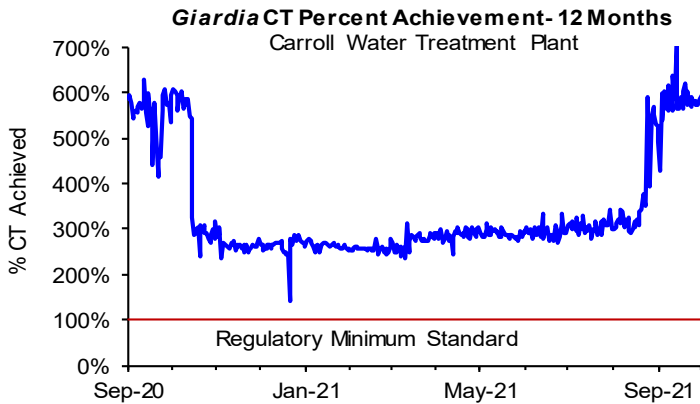

# Treated Water – Disinfection, pH and Alkalinity Results September 2021

## Quabbin Reservoir at Brutsch Water Treatment Facility (BWTF) (CVA Supply)

- The chlorine dose at BWTF is adjusted in order to achieve MWRA's seasonal target of 0.75 - 0.85 mg/L (November 1 – May 31) and 0.85 - 1.05 mg/L (June 1 – October 31) at Ludlow Monitoring Station.
- The chlorine dose at BWTF varied between 1.70 and 1.75 mg/L for September.
- Giardia* CT was maintained above 100% at all times the plant was providing water into the distribution system for September.
- Cryptosporidium* IT was maintained above 100% during the month. Off-spec water was less than 5%.

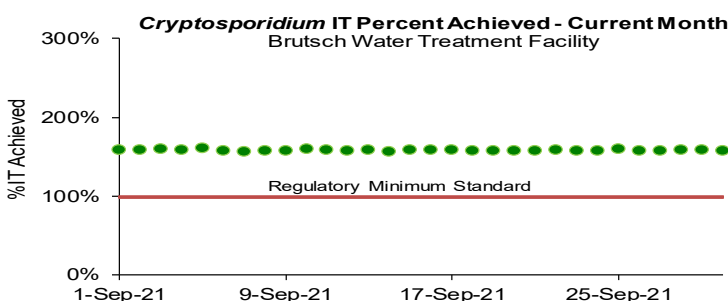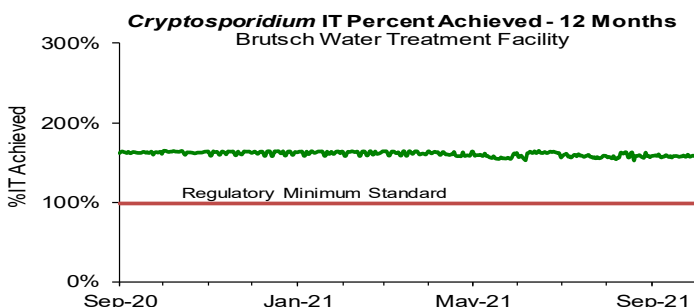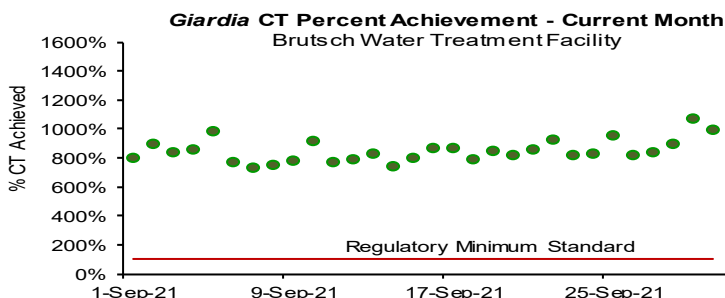
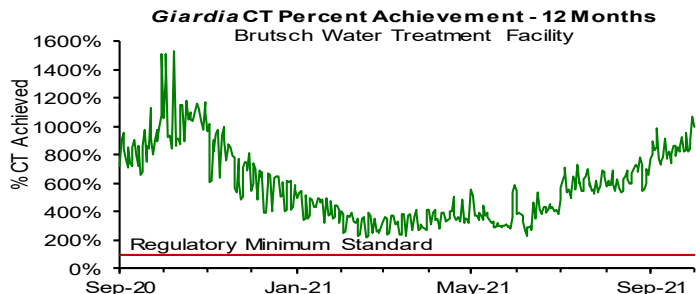


## Treated Water - pH and Alkalinity Compliance

MWRA adjusts the alkalinity and pH of Wachusett water at CWTP to reduce its corrosivity, which minimizes the leaching of lead and copper from service lines and home plumbing systems into the water. MWRA's target for distribution system pH is 9.3; the target for alkalinity is 40 mg/L. Per DEP requirements, samples from the CWTP finished water have a minimum compliance level of 9.1 for pH and 37 mg/L for alkalinity. Samples from 27 distribution system locations have a minimum compliance level of 9.0 for pH and 37 mg/L for alkalinity. Results must not be below this level for more than 9 days in a six-month period. MWRA tests finished water pH and alkalinity daily at the CWTP Fin B sampling tap. When CWTP undergoes winter maintenance, samples are collected at the CWTP Fin A sampling tap. Distribution system samples are collected in March, June, September, and December.

Each CVA community provides its own corrosion control treatment. See the CVA annual report: [www.mwra.com/water/html/awqr.htm](http://www.mwra.com/water/html/awqr.htm).

Quarterly distribution system samples were collected over a course of two weeks in September. Distribution system sample pH ranged from 9.1 to 9.6 and alkalinity ranged from 39 to 42 mg/L. In September and over the past six months, no sample results were below the compliance levels.

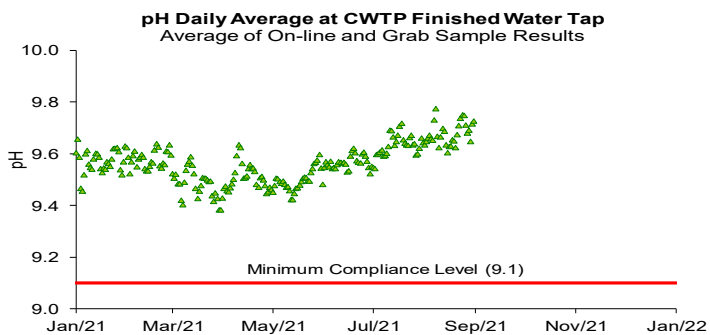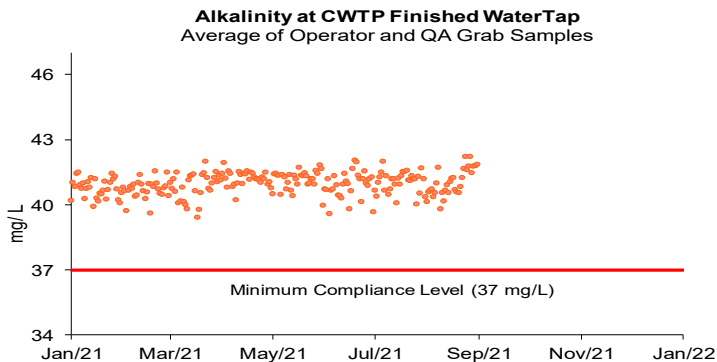



# Bacteria & Chlorine Residual Results for Communities in MWRA Testing Program September 2021

While all communities collect bacteria samples and chlorine residual data for the Total Coliform Rule (TCR), data from the 44 systems that use MWRA's Laboratory are reported below. The MWRA TCR program has 144 sampling locations. These locations include sites along MWRA's transmission system, water storage tanks and pumping stations, as well as a subset of the community TCR locations. Samples are tested for total coliform and *Escherichia coli* (*E.coli*). *E.coli* is a specific coliform species whose presence likely indicates potential contamination of fecal origin. If *E.coli* are detected in a drinking water sample, this is considered evidence of a potential public health concern. Public notification is required if repeat tests confirm the presence of *E.coli* or total coliform. Total coliform provide a general indication of the sanitary condition of a water supply. If total coliform are detected in more than 5% of samples in a month (or if more than one sample is positive when less than 40 samples are collected), the water system is required to investigate the possible cause with a Level 1 or 2 Assessment, and correct any identified problems. A disinfectant residual is intended to maintain the sanitary integrity of the water; MWRA considers a residual of 0.2 mg/L a minimum target level at all points in the distribution system.


## Highlights

One hundred and forty-eight of the 2,421 samples (6.11%) system-wide tested positive for total coliform during the month of September. Nine of the 669 Community/MWRA shared samples (1.35%) tested positive for total coliform during the month of September. The following communities (Everett, Medford, Norwood, Stoneham) had greater than 5.0% of their samples that were total coliform positive in September and, therefore, are required to conduct a Level 1 Assessment. Winchester had more than one positive total coliform sample in September and, therefore, is required to conduct a Level 1 Assessment. Bedford, Wakefield, and Winthrop are required to conduct a Level 2 Assessment since this their the second occurrence within a rolling 12-month period. Seven samples were discounted by DEP in Boston due to demonstration that the positives were not representative of the distribution system. No samples tested positive for *E.coli*. 2.8% of the Fully Served community samples had chlorine residuals lower than 0.2 mg/L.

## NOTES:

- MWRA total coliform and chlorine residual results include data from community locations. In most cases these community results are indicative of MWRA water as it enters the community system; however, some are strongly influenced by local pipe conditions. Residuals in the MWRA system are typically between 1.0 and 2.8 mg/L.
- The number of samples collected depends on the population served and the number of repeat samples required.
- These communities are partially supplied, and may mix their chlorinated supply with MWRA chloraminated supply.
- Chicopee Valley Aqueduct System. Free chlorine system.
- Wakefield's sample collection for September was extended through October 1 due to a repeat sampling event.

**Monthly Total Coliform Positives**

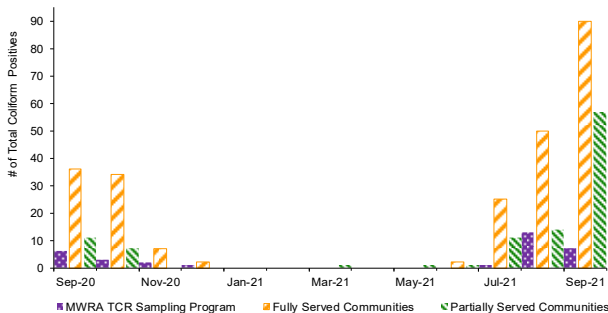

	Total Coliform		<i>E.coli</i> Positive	# Assessment Required
	# Samples (b)	# (%) Positive		
<b>MWRA</b>	MWRA Locations	129	0 (0%)	0
	Shared Community/MWRA sites	540	9 (1.67%)	0
	<b>Total: MWRA</b>	669	9 (1.35%)	0
<b>Fully Served</b>	ARLINGTON	63	0 (0%)	0
	BELMONT	32	0 (0%)	0
	BOSTON	309	12 (3.88%)	0
	BROOKLINE	69	0 (0%)	0
	CHELSEA	52	0 (0%)	0
	DEER ISLAND	16	0 (0%)	0
	EVERETT	58	4 (6.90%)	0
	FRAMINGHAM	82	1 (1.22%)	0
	LEXINGTON	46	0 (0%)	0
	LYNNFIELD	6	0 (0%)	0
	MALDEN	78	2 (2.56%)	0
	MARBLEHEAD	24	0 (0%)	0
	MARLBOROUGH	42	0 (0%)	0
	MEDFORD	73	5 (6.85%)	0
	MELROSE	42	2 (4.76%)	0
	MILTON	34	0 (0%)	0
	NAHANT	10	0 (0%)	0
	NEWTON	92	0 (0%)	0
	NORTHBOROUGH	16	0 (0%)	0
	NORWOOD	45	6 (13.33%)	0
	QUINCY	125	1 (0.80%)	0
	READING	50	0 (0%)	0
	REVERE	60	0 (0%)	0
	SAUGUS	32	0 (0%)	0
	SOMERVILLE	87	1 (1.15%)	0
	SOUTHBOROUGH	10	0 (0%)	0
	STONEHAM	38	4 (10.53%)	0
	SWAMPSCOTT	18	0 (0%)	0
	WALTHAM	78	2 (2.56%)	0
	WATERTOWN	53	1 (1.89%)	0
	WESTON	15	0 (0%)	0
	WINTHROP	67	49 (73.13%)	0
	<b>Total: Fully Served</b>	1822	90 (4.94%)	0
<b>Partially Served</b>	BEDFORD	55	45 (81.82%)	0
	BURLINGTON	44	0 (0%)	0
	CANTON	29	0 (0%)	0
	NEEDHAM	41	0 (0%)	0
	PEABODY	61	0 (0%)	0
	WAKEFIELD	71	6 (8.45%)	0
	WELLESLEY	38	0 (0%)	0
	WILMINGTON	29	0 (0%)	0
	WINCHESTER	37	6 (16.22%)	0
	WOBURN	63	1 (1.59%)	0
<b>Total: Partially Served</b>	468	58 (12.39%)	0	
<b>CVA</b>	MWRA CVA Locations	34	0 (0%)	0
	CHICOPEE	62	0 (0%)	0
	SOUTH HADLEY FD1	20	0 (0%)	0
	WILBRAHAM	15	0 (0%)	0
<b>Total: CVA</b>	131	0 (0%)	0	
<b>Total: Community Samples</b>	2421	148 (6.11%)	0	

**Chlorine Residuals in Fully Served Communities**

	2020				2021								
	Sep	Oct	Nov	Dec	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep
% <0.1	0.3	0.2	0.3	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.3	0.3	0.7
% <0.2	1.0	1.1	1.4	0.4	0.2	0.1	0.0	0.0	0.0	0.2	0.7	1.3	2.8
% <0.5	4.1	5.1	3.7	2.5	1.9	0.8	0.2	0.3	0.2	0.6	2.6	6.0	12.3
% <1.0	10.7	12.2	9.3	5.3	3.6	2.5	1.5	2.0	1.0	2.1	8.6	17.3	27.9
% ≥1.0	89.4	87.8	90.7	94.7	96.5	97.6	98.5	98.0	99.0	97.9	91.4	82.7	72.1

# Treated Water - Disinfection By-Product (DBP) Levels in Communities September 2021

Total Trihalomethanes (TTHMs) and Haloacetic Acids (HAA5s) are by-products of disinfection treatment with chlorine. TTHMs and HAA5s are of concern due to their potential adverse health effects at high levels. EPA's locational running annual average (LRAA) standard is 80 µg/L for TTHMs and 60 µg/L for HAA5s.



The locational running annual average at each individual sampling location must be below the standard. The charts below show the highest and lowest single values for all sites, and the LRAA of the highest location each quarter.

Partially served and CVA communities are responsible for their own compliance monitoring and reporting, and must be contacted directly for their individual results. The chart below combines data for all three CVA communities data (Chicopee, Wilbraham and South Hadley FD1). Each community is regulated individually.



Bromate is tested monthly as required for water systems that treat with ozone. Bromide in the raw water may be converted into bromate following ozonation. EPA's RAA Maximum Contaminant Level (MCL) standard for bromate is 10 µg/L.

The LRAA for TTHMs and HAA5s for MWRA's Compliance Program (represented as the line in the top two graphs below) remains below current standards. The Max LRAA in the quarter for TTHMs = 19.5 µg/L; HAA5s = 14.5 µg/L. The current RAA for Bromate = 0.0 µg/L. No LRAA exceedances or violations occurred this quarter for MetroBoston and for any of the CVA communities. MWRA and the CVA communities continue to closely monitor and manage the disinfection process to minimize DBP production.

## MetroBoston Disinfection By-Products

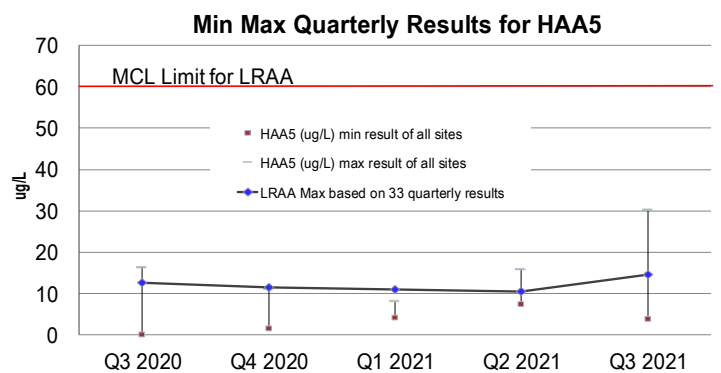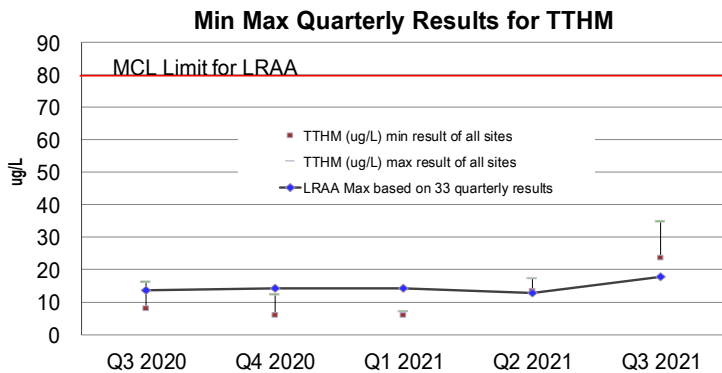

## CVA Disinfection By-Products (Combined Results)

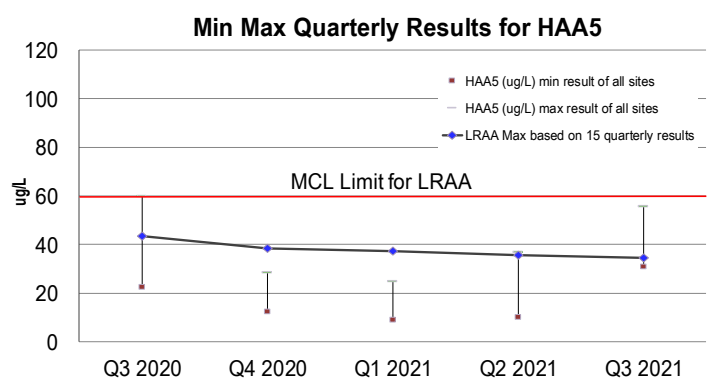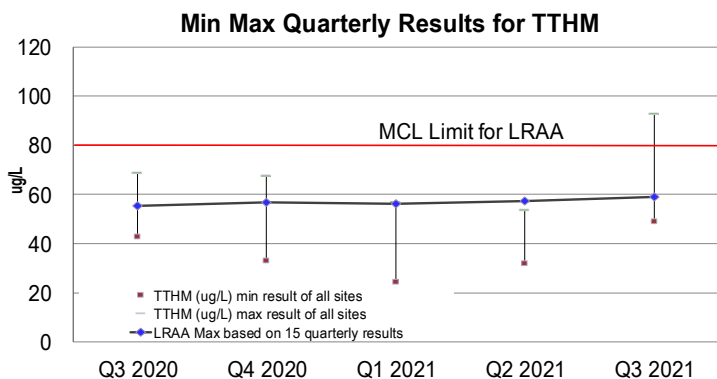



# MWRA Monthly Water Quality Analysis

## September 2021

This page provides information on water quality at four locations in the MWRA transmission system. Results reflect a "snapshot" in time and may not represent typical conditions. Monitoring for parameters indicated in regular font is quarterly as they either have minimal variability or are always below detection limits. The "Wachusett System" locations represent raw water from the Wachusett Reservoir (CWTP inlet) and finished water leaving the treatment plant (CWTP Finished water tap). The "CVA System" locations represent raw water from the Quabbin Reservoir (Brutsch Water Treatment Facility) and finished water after all treatment (Ludlow Monitoring Station). See [www.mwra.com](http://www.mwra.com) for additional information on other parameters which are monitored less frequently. All samples are analyzed by MWRA and contract laboratories.

Component	CVA System		Wachusett System Metro-Boston		Standards			Method Reporting Limit
	Brutsch Water Treatment Facility (Raw)	Ludlow Monitoring Station (Treated)	Carroll Water Treatment Plant Inlet (Raw)	Carroll Water TP Fin. Water Tap (Treated)	Health Standard	Aesthetics or Other Standards	Units	
Alkalinity <sup>(3)</sup>	<b>3.5</b>	<b>4.5</b>	<b>6.8</b>	<b>41.3</b>			MG/L	0.05
Aluminum	U	U	19.2	<b>U</b>		50-200 (c)	UG/L	15.0
Ammonia-N, Total	U	U	U	0.431			MG/L	0.005
Antimony	U	U	U	U	6 (b)		UG/L	0.4
Arsenic	U	U	U	U	10 (b)		UG/L	1.0
Barium	5.94	5.73	10	10.1	2000 (b)		UG/L	2.0
Beryllium	U	U	U	U	4 (b)		UG/L	0.3
Bromate	<b>U</b>	<b>U</b>	<b>U</b>	<b>U</b>	10 (b)		UG/L	5.0
Bromide	<b>11.3</b>	<b>5.6</b>	<b>18.3</b>	<b>12.4</b>			UG/L	5.0
Cadmium <sup>(1)</sup>	U	U	U	U	5 (b)		UG/L	0.5
Calcium	2160	2200	4750	<b>4810</b>			UG/L	50
Chloride	<b>8.1</b>	9.9	<b>27.1</b>	<b>30.9</b>		250 (c)	MG/L	0.5
Chlorine, Free		<b>0.95</b>			4 (b)(d)		MG/L	0.02
Chlorine, Total				<b>3.0</b>	4 (b)(d)		MG/L	0.02
Chromium, Total	U	U	U	U	100 (b)		UG/L	1.0
Coliform, Fecal, MF Method	<b>U</b>		<b>2</b>		20 (a)		CFU/100 mL	1
Coliform, Total, Colilert Method <sup>(4)</sup>	<b>2452</b>	<b>U</b>	<b>458</b>	<b>U</b>	100 (a) 0 (b)		MPN/100 mL	1
Color	6	6	16	5		15 (c)	CU	
Copper **	U	U	U	<b>U</b>		1300 (e) 1000 (f)	UG/L	3.0
Fluoride	U	U	U	<b>0.71</b>	4 (b)(h)		MG/L	0.02
Hardness <sup>(2)</sup>	7.48	7.52	15.50	17.00			MG/L	0.194
Iron **	U	U	43.3	<b>53.3</b>		300 (c)	UG/L	6.0
Lead **	U	U	U	0.11		15 (e)	UG/L	0.05
Magnesium	507	492	895	<b>881</b>			UG/L	35
Manganese	1.03	0.79	4.58	<b>7.87</b>		50 (c) 300 (g)	UG/L	0.1
Mercury <sup>(1)</sup>	U	U	U	U	2 (b)		UG/L	0.05
Nickel	U	U	U	U			UG/L	0.5
Nitrate-N	<b>0.0051</b>	U	<b>0.0551</b>	0.0463	10 (b)		MG/L	0.005
Nitrite	U	U	U	U	1 (b)		MG/L	0.005
Orthophosphate	<b>U</b>		<b>0.0026</b>	0.0038			MG/L	0.0025
pH <sup>(3)</sup>	<b>6.6</b>	<b>6.9</b>	<b>6.6</b>	<b>9.7</b>			S.U.	
Potassium	528	509	926	<b>1080</b>			UG/L	200
Selenium	U	U	U	U	50 (b)		UG/L	1.0
Silica (SiO <sub>2</sub> )	<b>1380</b>	1670	<b>2490</b>	<b>2920</b>			UG/L	200.0
Silver	U	U	U	U		100 (c)	UG/L	1.0
Sodium	5.9	7.08	18.7	35.7			MG/L	0.2
Specific Conductance	<b>50</b>	<b>56</b>	<b>136</b>	<b>217</b>			UMHO/cm	0.3
Standard Plate Count, HPC	<b>51</b>	<b>1</b>	<b>85</b>	<b>U</b>	500 (b)		CFU/mL	1
Sulfate (SO <sub>4</sub> )	<b>3.71</b>	3.96	<b>5.66</b>	<b>5.54</b>		250 (c)	MG/L	1.0
Thallium	U	U	U	U	2 (b)		UG/L	0.3
Total Dissolved Solids	25	30	83	115		500 (c)	MG/L	13
Total Organic Carbon	<b>2.2</b>	1.9	<b>2.8</b>	2.7			MG/L	0.3
Total Phosphorus	<b>U</b>	U	<b>0.008</b>	0.008			MG/L	0.005
UV-254	<b>0.026</b>	0.019	<b>0.082</b>	<b>0.043</b>			A/cm	0.000965
Zinc **	U	U	U	U		5000 (c)	UG/L	1.5

- (a) = Primary MCL standard (health related), applies to source (raw) water only. DEP "Drinking Water Regulations", 310 CMR 22.00. The Primary MCL for Fecal coliform when both fecal and total coliform are tested.
- (b) = Primary MCL standard (health related). DEP "Drinking Water Regulations", 310CMR 22.00. Applies to samples of treated water downstream of Wachusett and Quabbin Reservoirs. Most based on annual average.
- (c) = Secondary MCL standard (aesthetic related). DEP "Drinking Water Regulations", 310 CMR 22.00.
- (d) = Maximum Residual Disinfectant Level. DEP "Drinking Water Regulations", 310 CMR 22.00. Based on annual average.
- (e) = Refers to 90th percentile Action Level. Lead results will vary at your home dependent on household plumbing.
- (f) = Refers to a single sample, secondary MCL.
- (g) = DEP Advisory Level, reference [www.mass.gov/eea/docs/dep/water/drinking/alpha/i-thru-z/mangfactsheet.pdf](http://www.mass.gov/eea/docs/dep/water/drinking/alpha/i-thru-z/mangfactsheet.pdf)
- (h) = Fluoride level recommended by CDC for dental health is 0.7 mg/L

U = Less than method reporting limit  
MCL = Maximum Contaminant Level  
 = Not Applicable  
S.U. = Standard Units  
CFU = Colony Forming Unit

CU = Color Unit  
NTU = Nephelometric Turbidity Unit  
MG/L = milligrams per liter = parts per million  
UG/L = micrograms per liter = parts per billion

MPN = Most Probable Number  
HPC = Heterotrophic Plate Count (48 Hrs @ 35 °C)  
\*\* = Metal results may be elevated due to local plumbing at the sample tap.  
**\*Bold Italics = Samples from September**  
Regular Font = Quarterly results from July samples

\*Results reported are from single grab samples collected September 7, 2021

**NOTES:**

- (1) Due to MWRA lab equipment having higher sensitivity, MWRA's tests for several parameters are more sensitive than the EPA-set levels of detection and reporting. For example, the EPA minimum detection limit for cadmium is 1 ug/L and 0.2 ug/L for mercury, and MWRA lab tests and reports at lower than these detection limits.
- (2) MWRA water is considered soft. Water hardness is characterized by the amount of dissolved minerals in the water, in particular calcium and magnesium. MWRA water has a hardness of about 15-20 mg/l or about 1 grain/gallon (1 grain/gallon = 17.1 mg/L). For comparison, hard water would have greater than 75 mg/l hardness.
- (3) MWRA adjusts the alkalinity and pH. See page 6 for further details.
- (4) In reviewing the historical data record for Quabbin and Wachusett Reservoir, elevated total coliforms are a seasonal occurrence, generally occurring early July through October. When measuring both total and fecal coliform in source water, Surface Water Treatment Rule compliance in an unfiltered system is based on the fecal coliform level.